

MIAMI-DADE COUNTY, FLORIDA METRO-DADE FLAGLER BUILDING 140 WEST FLAGLER STREET, SUITE 1603 MIAMI, FLORIDA 33130-1563 (305) 375-2901 FAX (305) 375-2908

## **NOTICE OF ACCEPTANCE (NOA)**

Clopay Building Products Company 222 Kapik Road Hernando, MS 38632

#### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: 16' Rolling Steel Door** 

**APPROVAL DOCUMENT:** Drawing No. 1-01-10-06, titled "DADE COUNTY DOORS 60/55 PSF, 16' WIDE", sheets 1 through 2, prepared, signed sealed by Joseph Dixon, P.E., dated 4/15/96, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

# MISSILE IMPACT RATING: Large and Small Missile Impact

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.


**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.


This NOA renews NOA # 99-0226.01 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by Raul Rodriguez.



NOA No 02-0222.05 Expiration Date: March 7, 2007 Approval Date: April 11, 2002

Page 1

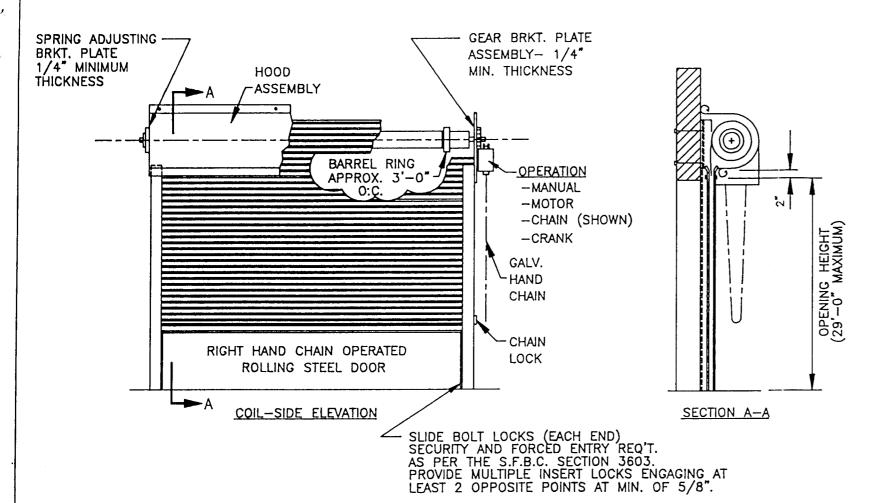



CURTAIN: C.R. GALV. SLATS; STRUCTURAL QUALITY (ASTM A-446), GRADE A. SLATS SHALL BE GALVANIZED WITH A MINIMUM COATING G90 ACCORDING TO ASTM A-525

#### GENERAL NOTES

- 1. THIS DOOR HAS BEEN TESTED ACCORDING TO PA201-94, PA202-94 AND PA203-94.
- 2. HOOD IS BOLTED TO THE BRACKET PLATE WITH 1/4" BOLTS. INTERMEDIATE SUPPORT IS FURNISHED FOR DOORS OVER 14'0" IN WIDTH.
- 3. CURTAIN IS BOLTED TO BARREL RINGS WITH 3/8" BOLTS.
- 4. SLATS ARE COLD ROLLED FROM GALVANIZED STEEL WITH A YIELD STRENGTH OF 40,000 PSI AND A WORKING STRESS OF 32,000 PSI.
- 5. ENDLOCKS AND WINDLOCKS ARE CAST MALLEABLE IRON.

- 6. THIS DRAWING HAS BEEN APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE.
- 7. WINDLOCK MATERIAL IS 1"x1/2"x1/8" STEEL CHANNEL (ASTM A36, DETAIL A).
- 8. THE DOOR HAS A DESIGN PRESSURE OF 55 PSF POSITIVE/ 60 PSF NEGATIVE AND A TEST PRESSURE OF 83 PSF POSITIVE/ 90 PSF NEGATIVE.
- ANCHOR BOLTS ARE RAWL—BOLT INSTALLED ON 4,000 PSI CONCRETE.
- 10. THE FOAMED IN PLACE INSULATION HAS BEEN TESTED ACCORDING TO ASTM E-84 AND 1929.


	REVIS. S							
ISSUE	DATE:	ECN NO	DESCRIPTION	APPVD				
1	9/1/95		ORIGINAL ISSUE	G.T. 9/1/				
2	9/11/95		UPDATE "FORCE ON STRUCTURE" DATA	G.T. 9/11/				
3	11/2/95		UPDATE "SCHEDULE" DATA	G.T. 11/2/				
4	12/20/95		UPDATE ANCHOR AND HEIGHT DATA	G.T. 12/20/:				
5	1/31/96		DELETE THERMAL DOOR	G.T. 1/31/9				
6	4/15/96		ADD THERMAL DOOR					

#### SCHEDULE FOR F-3 FLAT SLAT AND T-3 THERMAL SLAT

OPENING WIDTH	GAUGE	WINDLOCK SPACING	SLIP	WINDLOCK RIVETS	CUIDE ANGLE THICKNESS	WALL ANGLE THICKNESS	ANCHOR BOLTS	WALL ANGLE BOLTS	CUIDE ANGLE BOLTS
12'-1" TO 16'-0"	20	CONTINUOUS SLATS	1/2*	QTY. 3 3/16"	3/16" 3/16"	1/4*	5/8" 10"0.C 4" EMBDMNT		1/2" A490 18" 0.C.


### FORCE ON STRUCTURE (#/FT.)

	E-GUIDE						Z-GUIDE					
OPENING WIDTH	POS		NEG /		POS			NEG				
	F1	F2	F3	F1	F2	F3	F1	F2	F3	F1	F2	F3
12'-1" TO 16'0"	6180	5740	2070	7590	8070	2290	1760	1320	2070	3290	3770	2290

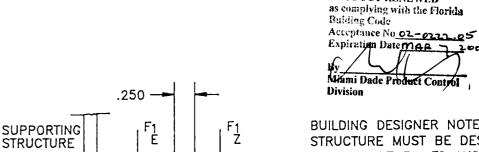

BUILDING DESIGNER NOTE:
STRUCTURE MUST BE DESIGNED
TO SUPPORT F1, F2 AND F3
FORCES (LBS./FT. OF OPENING HGT.)
AT EACH JAMB. VALUES OF F1,
F2 AND F3 ARE GIVEN IN
SCHEDULE.

PRODUCT RENEWED

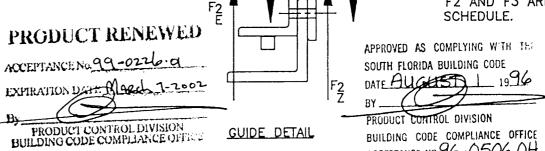


BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO.96-0.506.04

FL7768 4/29/96


NOTICE: Confidential/Proprietary information of atlas door corporation is contained herein and may not be disclosed, used, made available, duplicated, or distributed without its prior consent.

Fallure to observe this notice may result in liability for any damages and losses resulting therefrom.

auas -			
door corporation	Orlando, I	L • Nesbit, MS • Cha	ndler, AZ
TITLE: DADE COUNTY DOORS	60/55 PSF, 16' W	IDE STATE	JS: STD.
DRAWN BY: D. BRASWELL	DATE: 7/13/95	SCALE: NONE	DWG.
ENGINEER: J. DIXON	DATE: 7/13/95	SCALE: NONE SHEET 1 OF 2	SIZE 🗖
REGISTRATION NO: FL7768	ISSUE NO. 6	OWG. NO. 1-01-	10-06




PRODUCT RENEWED

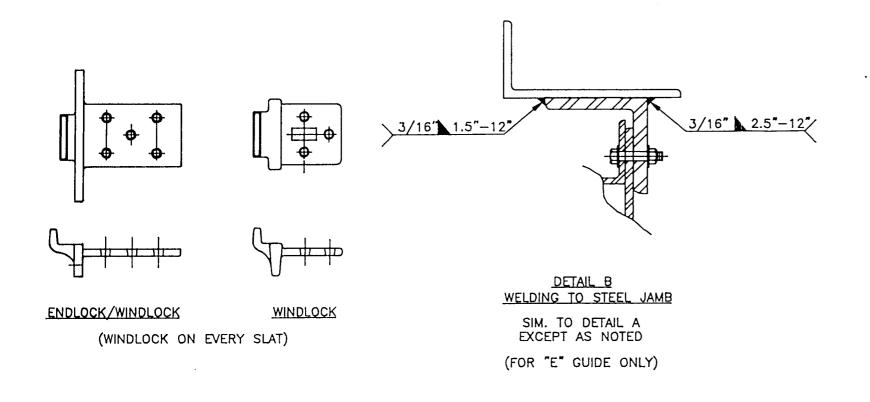

STEEL FLAT SLAT

-2"x1-1/2"x1/8" (TYP)

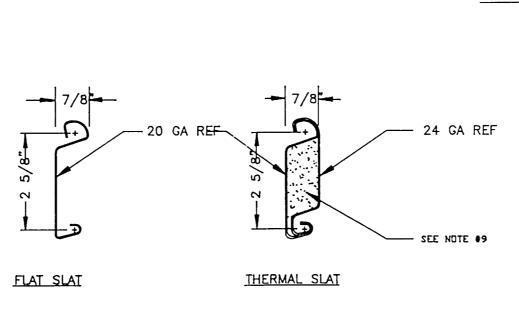

DETAIL C

PRODUCT CONTROL DIVISION

BUILDING CODE COMPLIANCE OFFICE

ACCEPTANCE NO.96-0506.04

DRAWN BY:	P.SPIKES	DATE: 9/1/9	35	SCALE: NO	NE	DWG.
CHECKED BY:	G. THOMAS	DATE: 9/1/9	95	SHEET 2 OF	2	SIZE
PART NO:		ISSUE NO.	6	DWG. NO.	1-01-	10-06

as complying with the Florida
Building Code Acceptance No 62-0222 Expiration Date MAR 7 Mismi Dade Product Control
Division MINIMUM 5"-SEE SCHEDULE FOR SIZE & SPACING - SEE NOTE 9 4"X3"X1/4" 3"x3"x1/4" STEEĹ MASONRY 7/8" SEE SCHEDULE FOR SIZE & SPACING OPENING WIDTH 1"X1/2"X1/8" WINDLOCK CHANNEL 3-1/2"x3-1/2"x1/4" PRODUCTRENEWAD DETAIL A ACCEPTANCENA 99-0226.01 BOLTING TO STEEL JAMB EXPERATION DATE MARCH 7-2002 & ANCHORING TO MASONRY PRODUCT CONTROL DIVERSION
BUILDING CODE COMPLIANCE OFFICE APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE

1110-06A

WIDTHx3"x1/8" — PRIME STEEL PLATE

#16 CARRIAGE BOLTS —
16" O.C. FROM CENTER BOLT
(PUNCHED MIDDLE
OF FLAT SLAT)

BOTTOM BAR